


StatArea
 ROADWAYS
 Illuminance (Fc)
 Average = 1.85
 Maximum = 5.5
 Minimum = 0.2
 Avg/Min Ratio = 9.25
 Max/Min Ratio = 27.50

NOTES:

1. PHOTOMETRICS PROVIDED BY KEN SWEENEY OF CHARRON, INC. FROM EMAIL DATED OCTOBER 30, 2012.
2. LIGHT POLE BASES SHALL BE DESIGNED BY A STRUCTURAL ENGINEER LICENSED IN THE STATE OF NEW HAMPSHIRE.
3. LIGHT POLES AND FIXTURES SHALL BE AS SPECIFIED BY CHARRON, INC. OR APPROVED EQUAL.

Symbol	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
○	9	D1	SINGLE	8500	0.750	LCSC-CG-HR-III-100MH/ 12' POLE
○	36	P2	SINGLE	21000	0.750	MPFR-SL-250/ 20' AFG
○	2	P3	SINGLE	21000	0.750	MPFR-SL-250/ 20' AFG
○	22	W	SINGLE	N.A.	1.000	XFOR3A/ WALL MTD 20' AFG
○	1	W1	SINGLE	N.A.	1.000	XFOR3A/ WALL MTD 12' AFG
○	2	W2	SINGLE	N.A.	1.000	ISS-B01-LED-E1-BL4/ WALL MTD 12' AFG

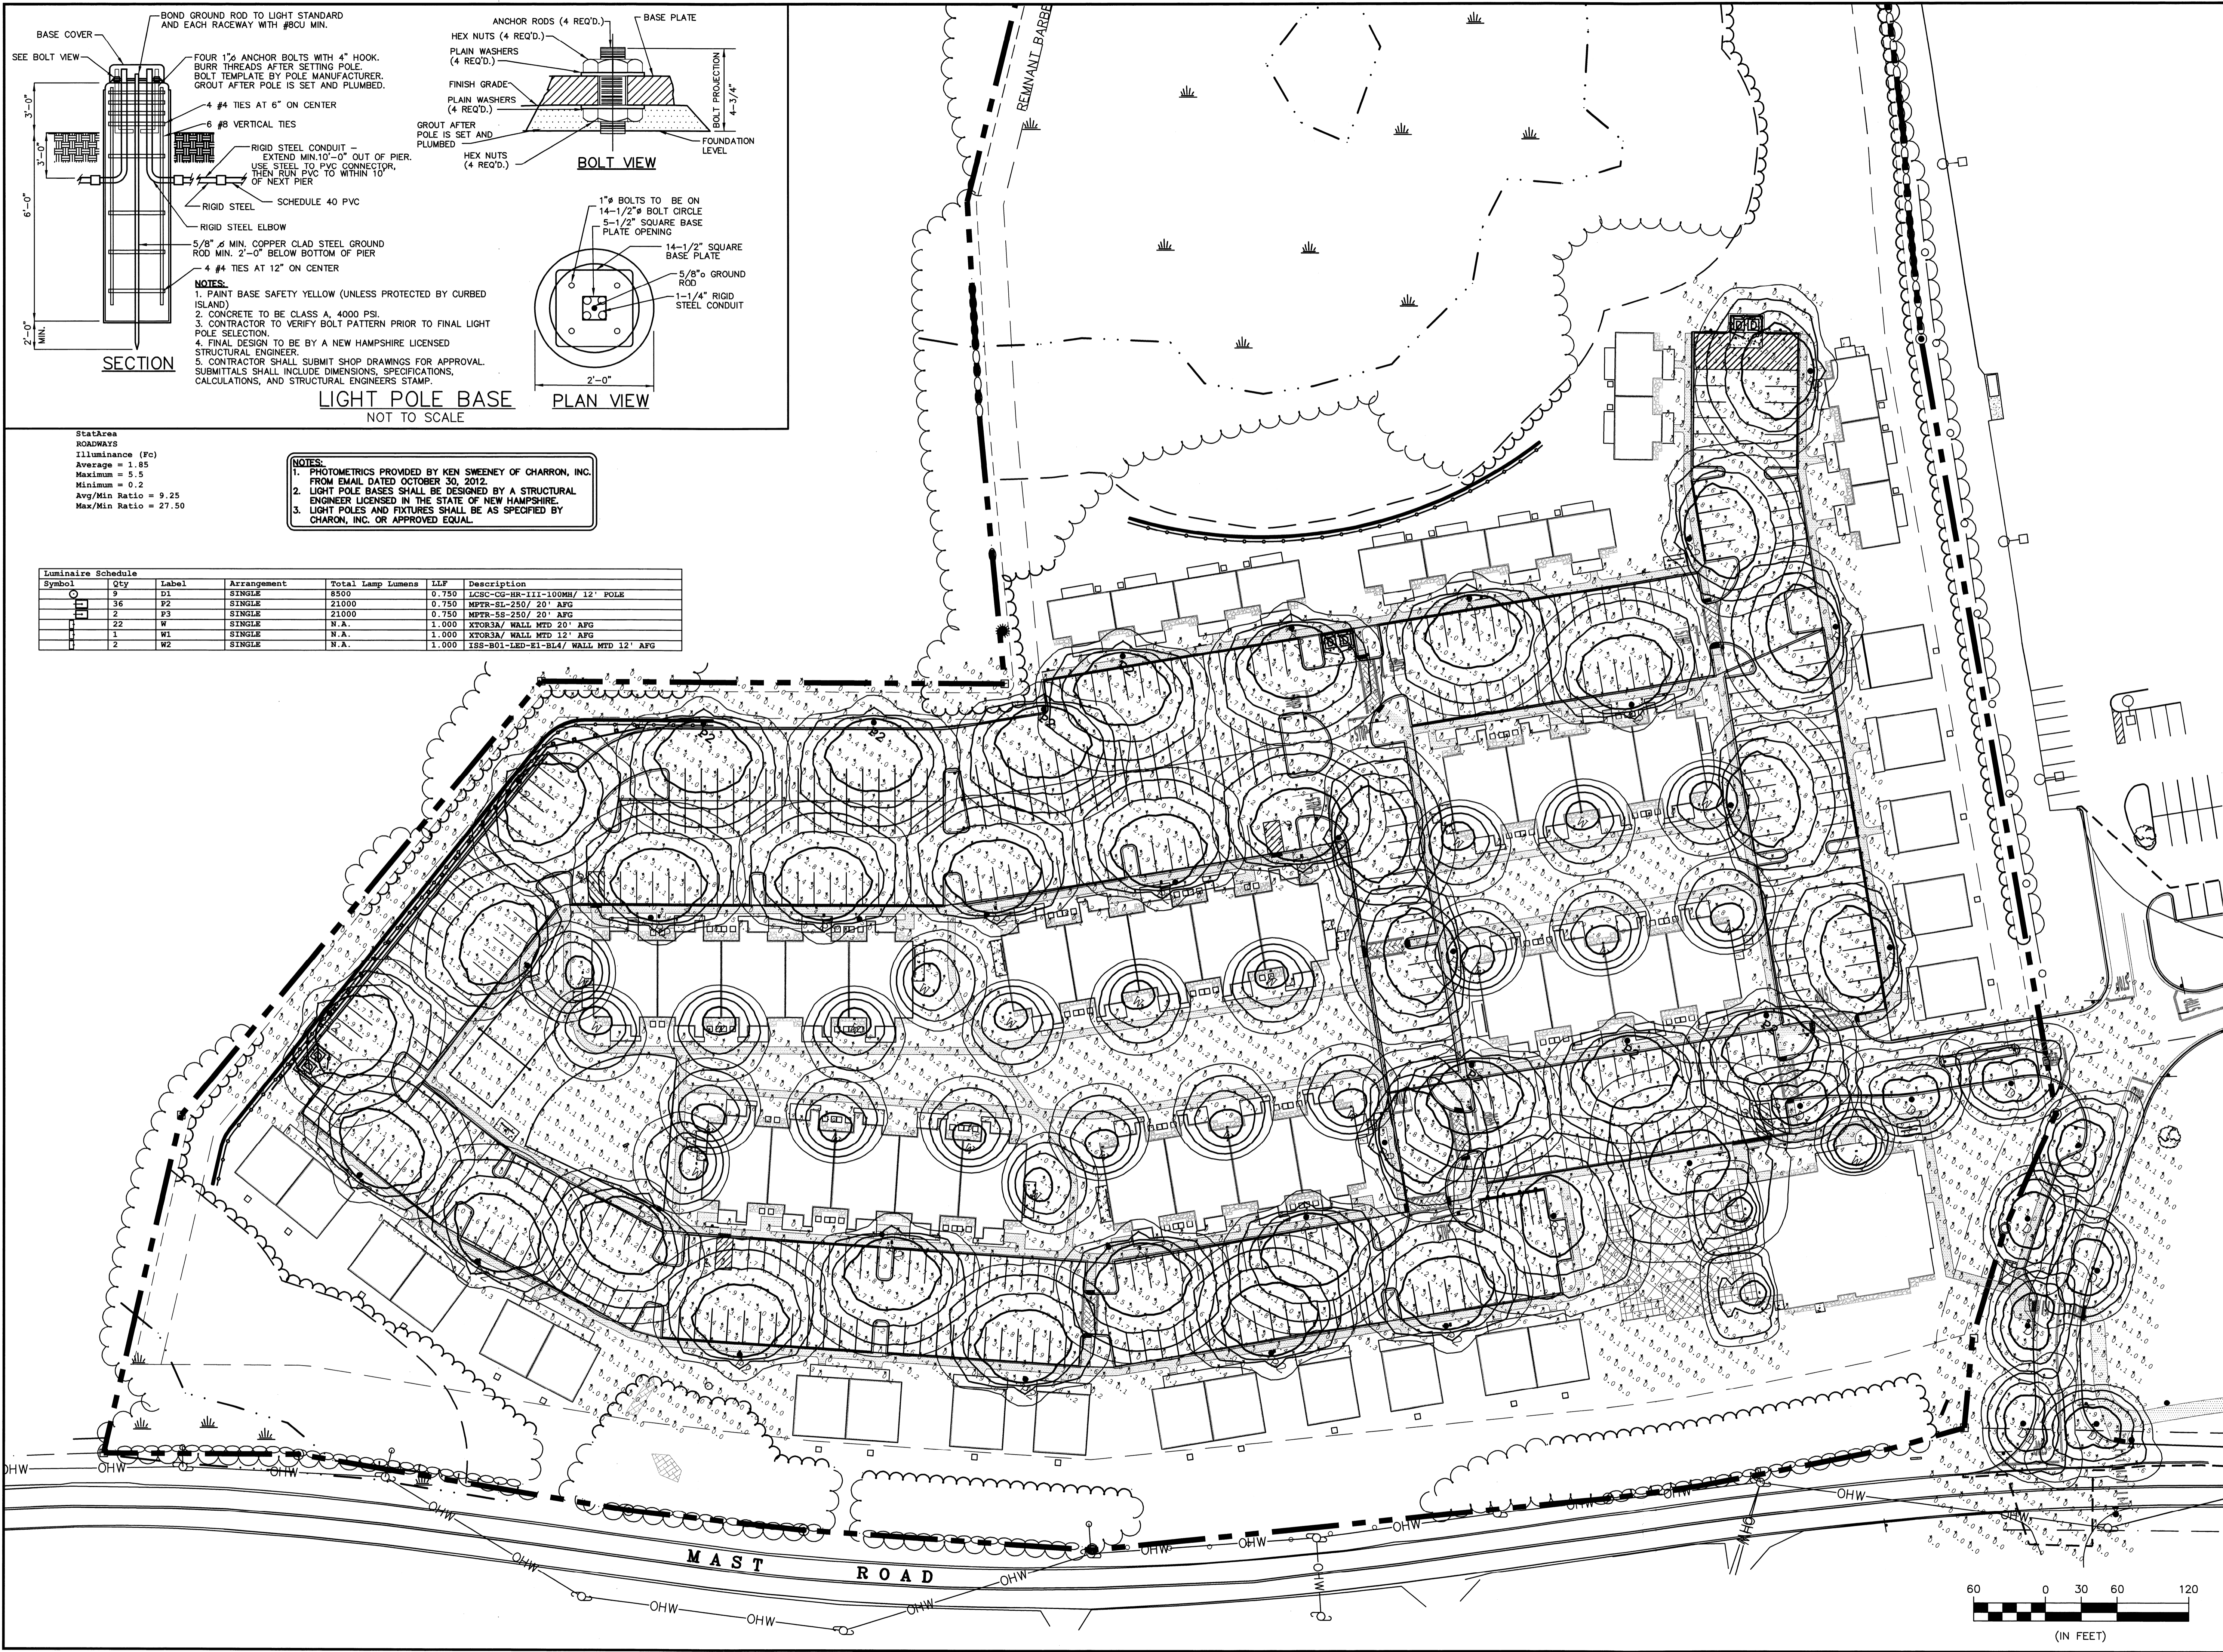

Peak Campus Development, LLC
 The Lodges at West Edge
 Durham, NH

Mark	Date	Description
D	6/11/13	ISSUED FOR BUILDING PERMIT
C	11/1/12	REVISED FOR PB SUBMISSION
B	9/26/12	REVISED FOR PB SUBMISSION
A	8/22/12	PB SUBMISSION

PROJECT NO: P0637
 FILE: P0637_PHOTO.dwg
 DRAWN BY: KAM/SLK1
 CHECKED: JMP2
 APPROVED BY: GMM

PHOTOMETRIC PLAN
 SCALE: AS SHOWN
 SHEET 23